

# Technical Data Lambda Probe LS2-HT



Fig. 1 Lambda Probe LS2-HT


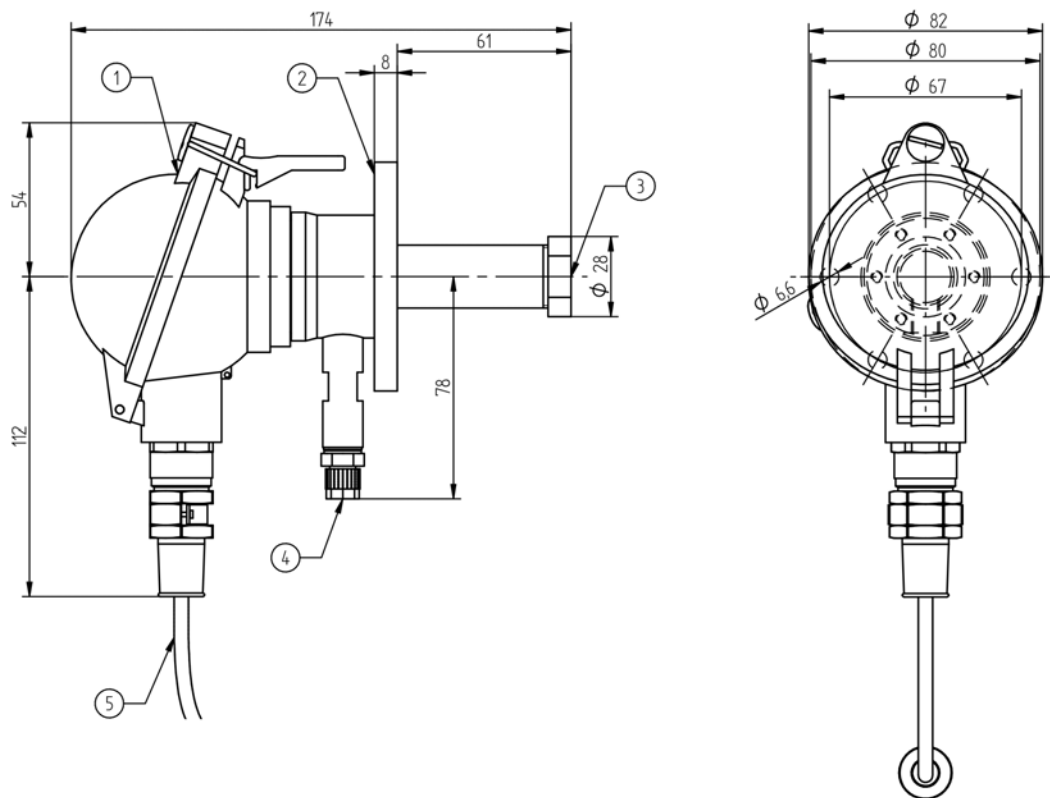


Fig. 2 Lambda Probe LS2-HT (dimensions in mm)

1	Junction box
2	Mounting flange
3	Filter disk
4	Hose connection 4/6 mm   0.16/0.24 "in for 7 Boiler wall (in this case with inner insulation) calibrating gas
5	Connecting cable, length 2 m   6.6 ft

## Technical Data Lambda Probe LS2-HT

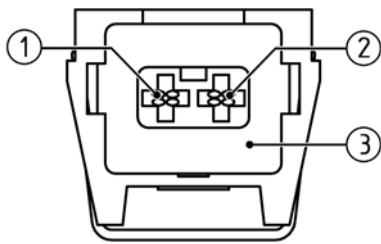

- 1 (+) Probe signal (black) (PCB/LT2 term. 34)
- 2 (-) Probe signal (grey) (PCB/LT2 term. 33)
- 3 Socket sensor signal
- 4 Probe heater (white) (PCB/LT2 term. 35)
- 5 Plug probe heater
- 6 Probe heater (white) (PCB/LT2 term. 36)


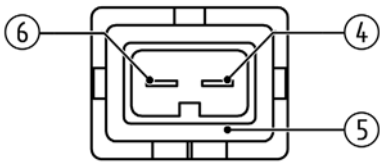


Fig. 3 Terminal assignment automotive plug

**For deliveries from: 01.04.2024.**

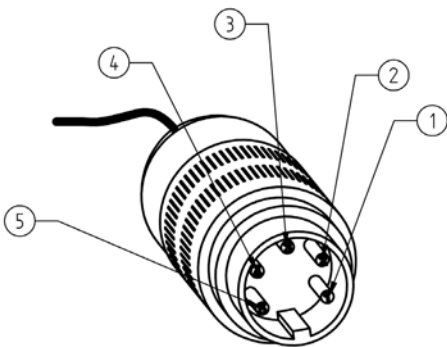

- 1 = (+) Probe signal O<sub>2</sub> (black)
- 2 = without function
- 3 = Probe heater (white)
- 4 = Probe heater (white)
- 5 = (-) Probe signal O<sub>2</sub> (red or blue)

Fig. 4 Pin assignment 5-pole round plug

## Technical Data Lambda Probe LS2-HT

Technical Data	
Measuring range	<b>O<sub>2</sub></b> : 0 - 21 % O <sub>2</sub>
Measuring precision	<b>O<sub>2</sub></b> : ± 5 % of measured value - not better than ± 0.3 vol. %
Sensor signal	<b>O<sub>2</sub></b> : -30 ... +150 mV
Response time	<b>O<sub>2</sub></b> : t <sub>60</sub> : < 3 s t <sub>90</sub> : < 9 s
Relaxation time (measurement readiness after overload)	<b>O<sub>2</sub></b> : t <sub>90</sub> : < 8 s
Offset to environment	<b>O<sub>2</sub></b> : < 0.3 vol. %
Repeating precision	<b>O<sub>2</sub></b> : < 0.1 % deviation from measured value
Drift	<b>O<sub>2</sub></b> : < 1.7 % from measured value (after 1000 h of operation in EL light fuel oil and 1004 switching cycles ON / OFF)
Cross sensitivity	<b>O<sub>2</sub></b> : to CO <sub>2</sub> (15 vol. %) < 0.1 vol. % <b>O<sub>2</sub></b> : to CO (874 ppm) < 0.1 vol. % <b>O<sub>2</sub></b> : to CH <sub>4</sub> (76 ppm) < 0.1 vol. % <b>O<sub>2</sub></b> : to SO <sub>2</sub> (76 ppm) < 0.1 vol. % <b>O<sub>2</sub></b> : to NO (245 ppm) < 0.1 vol. % (O <sub>2</sub> : Information assumes an operating gas composition of 5 vol. % O <sub>2</sub> , rest is N <sub>2</sub> )
Heating consumption	10 ... 25 W (at T <sub>gas</sub> 350 °C   662 °F approx. 18 W) (according to design, measuring gas temperature, and measuring speed)
Weight	1,300 g   2.86 lb
Material of probe housing	1.4571
Material of connection housing	Aluminium
Material of connecting line	NICKEL-plated copper strand FEP insulation
Measuring principle	Zirconium dioxide cell (ZrO <sub>2</sub> ) potentiometric (voltage probe)
Approval	According to EN 16340:2014 D

## Technical Data Lambda Probe LS2-HT

Operating Condition	
Lifetime	> 3 years (in case of light fuel oil and natural gas)
Heating time	10 min until operating temperature is reached
Operating temperature of the measuring cell (sensor) at 13 V heating voltage in the air (20 °C   68 °F)	650 °C   1,202 °F
Mounting / measuring gas extraction device	Directly in exhaust gas channel / in situ
Seal tightness	$q_L \leq 100 \text{ cm}^3/\text{h}$ (According to DIN V 18160-1:2006-01, seal tightness towards environment through housing and fastening)
Mounting position	Horizontal to vertical
Permissible fuels	Residue-free, gaseous hydrocarbons, light fuel oil, heavy fuel oil (HFO), lignite and coal, biomass (according to design)
Ideal measuring gas speed	Without GED: – $1 \text{ m/s} \leq X \leq 6 \text{ m/s}$   $3.28 \text{ ft/s} \leq X \leq 19.69 \text{ ft/s}$ with GED BASE: – $T < 100 \text{ °C}$ $1 \text{ m/s} \leq X \leq 10 \text{ m/s}$   $212 \text{ °F}$ $3.28 \text{ ft/s} \leq X \leq 32.81 \text{ ft/s}$ – $T > 100 \text{ °C}$ $1 \text{ m/s} \leq X \leq 20 \text{ m/s}$   $212 \text{ °F}$ $3.28 \text{ ft/s} \leq X \leq 65.67 \text{ ft/s}$ with GED FLEX: – $0.1 \text{ m/s} \leq X$ depending on version   $0.328 \text{ ft/s} \leq X$ depending on version  (Higher measuring gas speed increases the measurement error. Measured at measuring gas temperature 25 °C   77 °F. In case of smaller measuring gas temperatures it might be necessary to protect the probe from the incident flow.) <b>Attention:</b> For lengths of GED FLEX > 1 m   3.28 ft, a higher measuring gas speed (> 30 m/s   98.42 ft/s) can lead to flutter and vibration of GED.
Reference air supply	Not required
Flange adapter	Depending on the selected GED

### Environmental Conditions

<b>Probe head</b>	permissible flue gas temperature	< 450 °C   842 °F
<b>Operation</b>	permissible temperature	< 100 °C   212 °F on cable gland < 100 °C   212 °F on connection cable
<b>Transport</b>	permissible temperature	-20 ... +70 °C   -4 ... +158 °F
<b>Storage</b>	permissible temperature	-20 ... +70 °C   -4 ... +158 °F
<b>Degree of protection</b>	according DIN EN 40050	IP65

\* According to DIN V 18160-1:2006-01, seal tightness towards environment through housing and fastening.

### NOTICE

The limits of the technical data must be strictly adhered to.

# Technical Data Lambda Probe LS2-HT

## Order Information

**Lambda Probe LS2-HT for measurement of oxygen (O<sub>2</sub>),  
for flue gas temperatures up to 1.400 °C | 2,552 °F in combination with GED FLEX or GED BASE**

Description / Type	Order no.
Lambda Probe LS2-HT, cable length 2 m   6.6 ft, IP65, incl. automotive plug, IP65, seal for connecting head, Novaphit SSTC	650R1515
Lambda Probe LS2-HT, cable length 5 m   16.40 ft, IP65, incl. automotive plug, IP65, seal for connecting head, Novaphit SSTC	650R1516
Probe LS2-HT, cable length 2 m   6.6 ft, incl. round plug 5 pins, IP65, seal for connecting head, Novaphit SSTC	650R2015
Lambda Probe LS2-HT, cable length 5 m   16.5 ft, incl. round plug 5 pins, IP65, seal for connecting head, Novaphit SSTC	650R2016

**Additional required:**

For measurements without purge operation, without fully automatic calibration

- Lambda Transmitter LT3, configured for LS2  
Order no. 657R51 / ... / LS2R / ...
- Gas extraction device GED BASE or GED FLEX

For measurements without purge operation (cyclic triggering)

- Lambda Transmitter LT2, configured for LS2 with round plug in application 'purge operation'  
Order no. 657R102 / LS2R / 3A / ...
- Gas extraction device GED FLEX, T-adapter for purge operation
- Dedusting / purge unit, IP65, for T-adapter GED FLEX order no. 657R0934

For measurements without purge operation (manual triggering)

- Lambda Transmitter LT3, configured for LS2 with round plug,  
Order no. 657R51 / ... / LS2R / ...
- Gas extraction device GED FLEX, T-adapter for purge operation
- Dedusting / purge unit, IP65, for T-adapter GED FLEX order no. 657R0934

For measurements with automatic calibration

- Lambda Transmitter LT2, configured for LS2 with round plug in application "automatic calibration"  
Order no. 657R102 / LS2R / V / ...
- Gas extraction device GED BASE or GED FLEX
- Fully automatic calibration system, order no. 657R0940

For measurements with dedusting operation (cyclic triggering) and automatic calibration

- Lambda Transmitter LT2, configured for LS2 with round plug in application " automatic calibration and dedusting operation  
Order no. 657R102 / LS2R / V / ...
- Gas extraction device GED FLEX, T-adapter for ejector
- Dedusting/purge unit, IP65, for T-adapter GED FLEX order no. 657R0934
- Fully automatic calibration system, order no. 657R0940

The information in this publication is subject to technical changes.



**LAMTEC Meß- und Regeltechnik  
für Feuerungen GmbH & Co. KG**

Josef-Reiert-Straße 26

D-69190 Walldorf

Telefon: +49 (0) 6227 6052-0

Telefax: +49 (0) 6227 6052-57

[info@lamtec.de](mailto:info@lamtec.de)  
[www.lamtec.de](http://www.lamtec.de)

