



**LAMTEC innovation**


## Modular CO $\lambda$ Control for Biomass Combustion Plants

- Saves fuel and operating costs
- Reduces CO<sub>e</sub>, dust and NO<sub>x</sub> emissions
- Easy retrofitting to existing biomass combustion plants

Sensors and systems for combustion technology



[www.lamtec.de](http://www.lamtec.de)

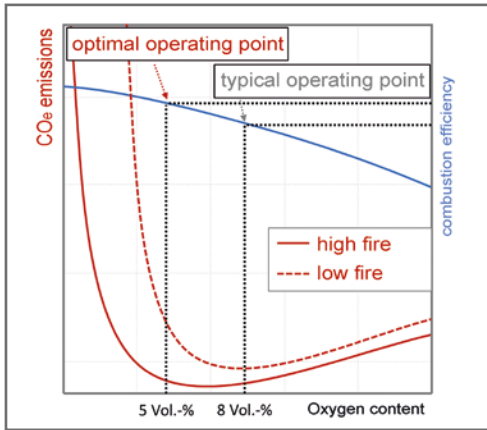

## Principle of CO λ control

The lower the oxygen content of the flue gas is set, the greater the effectiveness of the biomass combustion plant.


If oxygen contents are too low, however, the result is incomplete combustion and extremely high CO<sub>e</sub> emissions.

**CO λ control sets an optimum oxygen content which simultaneously maximises effectiveness and minimises CO<sub>e</sub> emissions for any firing rate condition.**

## Emissions savings through CO λ control

- Minimises fuel consumption, thus also reducing nitrogen oxide emissions (NO<sub>x</sub>).
- Minimises CO<sub>e</sub> emissions, at the same time reducing emissions of other pollutants (e.g. dust, PAH).

**In this way, CO λ control avoids typical problems associated with incomplete combustion (e.g. soiling of the heat exchanger).**

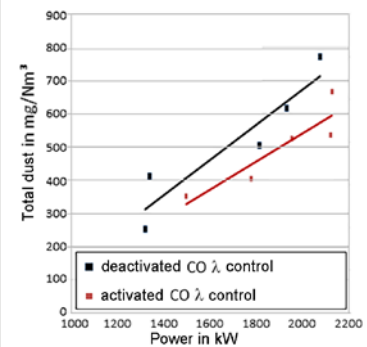

## Example: typical biomass heating plant

Nominal output: 5 MW<sub>th</sub>

Annual heat sales: 12,000,000 kWh

Annual fuel consumption: 16,000 m<sup>3</sup>

6,400 m<sup>3</sup> sawmill by-products (40 %)

9,600 m<sup>3</sup> forest wood chips (60 %)

Costs for forest wood chips: € 20 per m<sup>3</sup>

- 3.8 % fuel saving (forest wood chips)
- **Cost saving: € 7,296 per year**

In addition:

**30 % reduction of the flue gas mass flow and**

**45 % reduction of the secondary air mass flow**

## Cost savings

Preventing the problems associated with incomplete combustion reduces operating costs.

The increase in effectiveness resulting from the use of CO λ control - typically 2-4 % - significantly cuts fuel costs.

Electricity costs are also reduced due to lower fan speeds (e.g. secondary air and flue gas fan).


**As a result, investment in a CO λ control pays off after only a short time.**


## Long-term verification of CO λ control

The CO λ control was tested in a heating plant over an entire heating season.

**Heating plant:** Biomass combustion plant for wood chips for a local heating supply with a nominal output of 2.5 MW<sub>th</sub>.

- Tested over 5 months (November 2018 to March 2019)
- **1155 h operating hours** with CO λ optimisation
- Reduction of fuel consumption by **-3.8 %**
- Reduction of NO<sub>x</sub> emissions by **-3.8 %**
- CO emissions decreased by **-200 mg/Nm<sup>3</sup>** (see diagram, right)
- Total dust emissions decreased by **-19.5 %** (see diagram, top right)

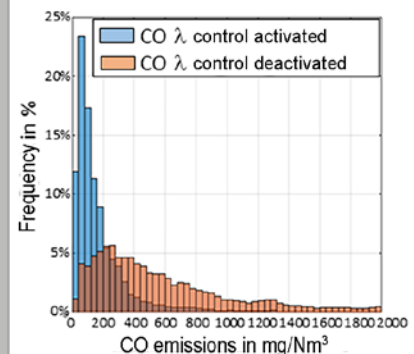

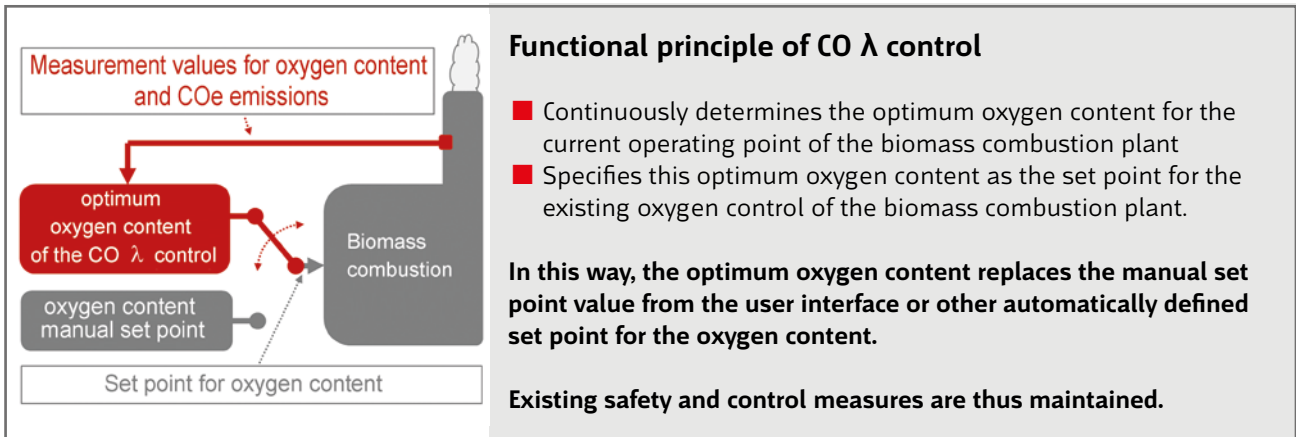


## Use of robust in-situ flue gas sensors

The CO λ control uses the robust Combination Probe KS1D together with the Lambda Transmitter LT3 (see image on the right).

This tried and tested sensor system, which has proved its worth in thousands of applications, supplies a measured value for CO<sub>e</sub> emissions as well as a measured value for the oxygen content.

The Combination Probe KS1D can be used to replace other commercially available oxygen probes, as it is identical in design as regards installation.

The Lambda Transmitter LT3 supplies the signals with the oxygen content and CO<sub>e</sub> emissions to the CO λ control.

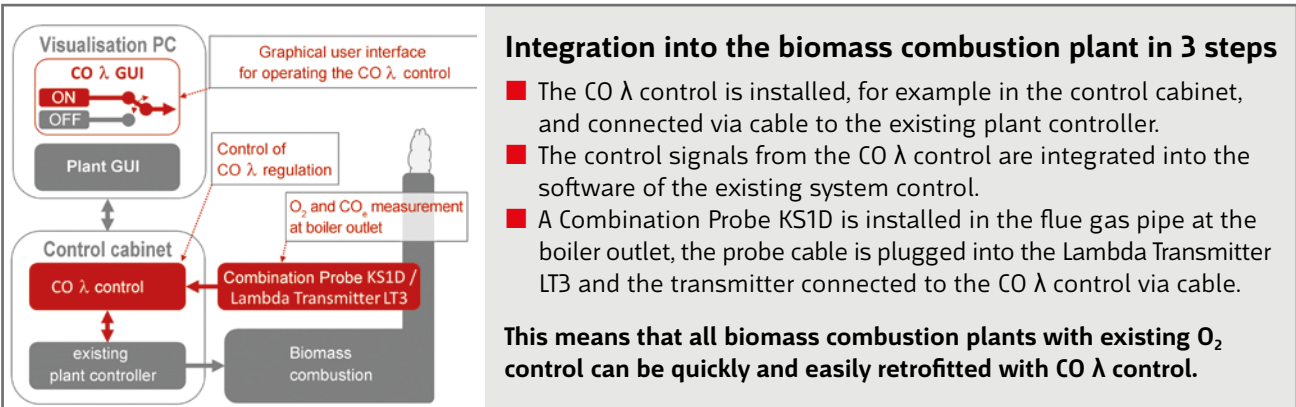

## Reference installation: Gastern

Operated by:  
Aigner Energie  
Contracting GmbH

Two biomass combustion plants  
for wood chips for the generation  
of process heat

Nominal output: 1,5 MW<sub>th</sub> each



**Image: Heating plant in Fuschl am See**

## Reference installation: Fuschl am See

Operated by: s.nahwaerme.at  
Energiecontracting GmbH

Biomass combustion plant for  
wood chips for local heating  
supply  
Nominal output: 2.5 MW<sub>th</sub>

# Components of the CO $\lambda$ Control

## LAMTEC Combination Probe KS1D

The LAMTEC Combination Probe KS1D is available in various versions. In combination with the Lambda Transmitter LT3, it forms an innovative measuring device for combustion plants of all types:

### Combination Probe KS1D



#### Characteristics:

- Measurement directly in the moist flue gas up to 300 °C.
- Flue gas with low dust load.
- Protection type IP42; if installed outdoors, the probe must be protected against water, snow, etc.

#### Areas of application:

- Natural gas, heating oil EI, biomass.

## Lambda Transmitter LT3



The LAMTEC Lambda Transmitter LT3 is supplied with a User Interface (UI). The LT3 is equipped with the following connections:

- Mains connection
- Connection for KS1D probe
- 2 x 4 - 20 mA signal for the measured O<sub>2</sub> and CO<sub>e</sub> value
- LAMTEC SYSTEM BUS (LSB) for connection to the modular CO  $\lambda$  control

## Combination Probe KS1D for manual cleaning



#### Characteristics:

- Measurement directly in the moist flue gas up to 450 °C.
- Adjustment during operation possible using test gas.
- Protection type IP65.
- Flue gas with moderate to high dust load.
- Manual compressed-air cleaning.

#### Areas of application:

- Natural gas, heating oil EI, heating oil S, coal, special fuels, biomass.

## LAMTEC CO $\lambda$ control module



The CO  $\lambda$  control module calculates the optimum oxygen content based on the KS1D probe data from the LT3 and specifies this value as the set point for the PLC of the biomass combustion plant. Among others, the module is equipped with the following connections:

- 24 VDC voltage supply
- Field bus (for connection to the LT3 and the system PLC)
- 2 x 4 - 20 mA signals
- Modbus TCP
- PROFIBUS DP
- OPC-UA



## LAMTEC Meß- und Regeltechnik für Feuerungen GmbH & Co. KG

Wiesenstraße 6  
D-69190 Walldorf  
Phone: +49 (0) 6227 6052-0  
Fax: +49 (0) 6227 6052-57

[info@lamtec.de](mailto:info@lamtec.de)

[www.lamtec.de](http://www.lamtec.de)

